Data Displays to Detect-Diagnose-Treat Critical Events (NIBIB)

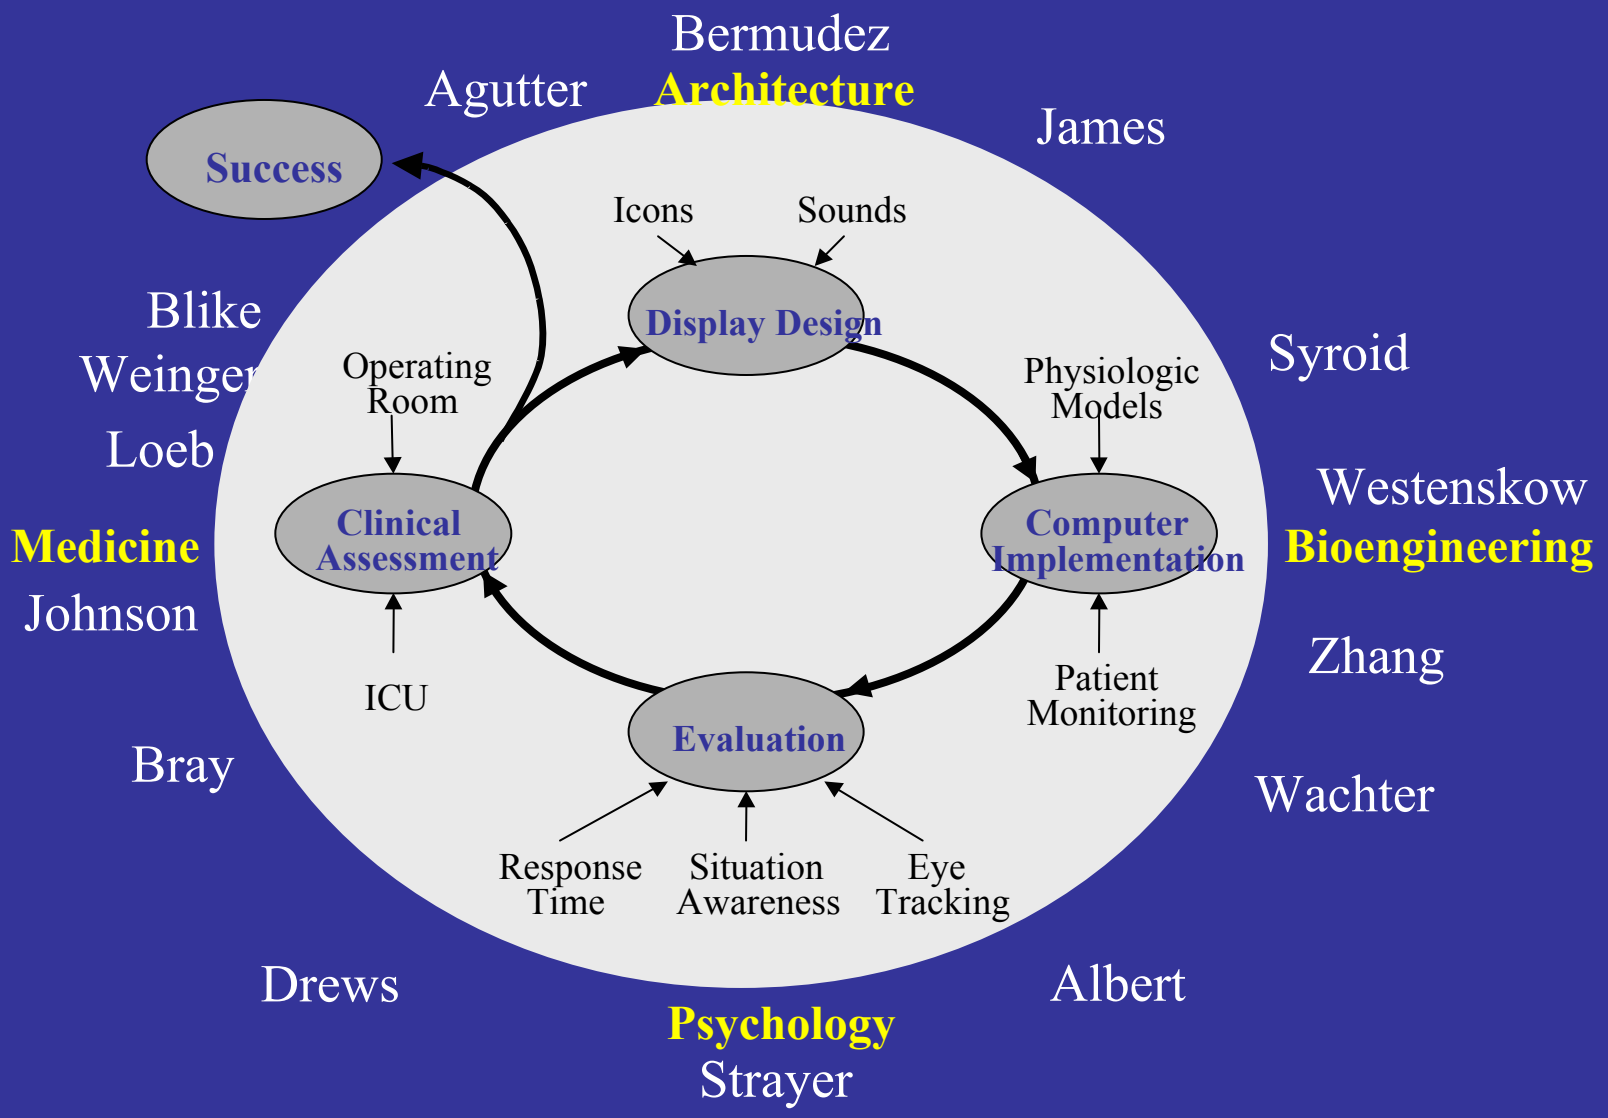

Recognition Time

- Recognize and Treat MI
  - With Display 3:33 min
  - Without Display 6:17 min
    - *p < .001*

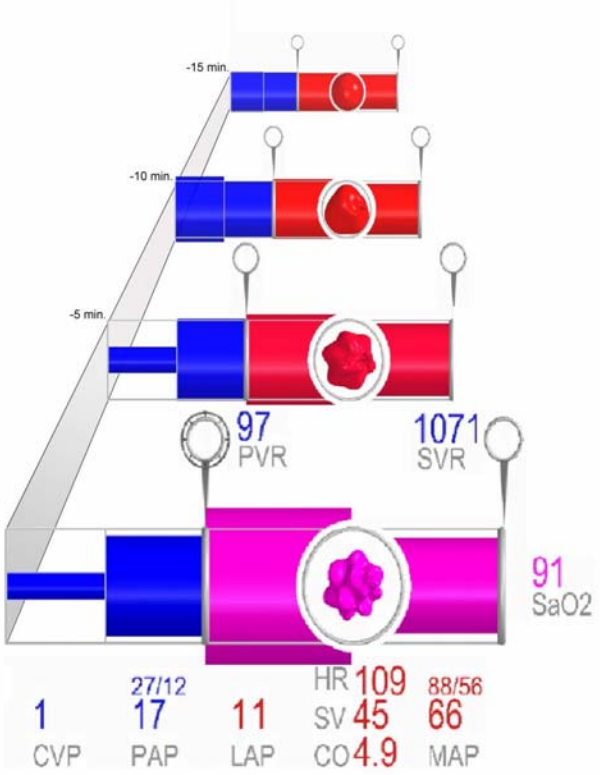

- Recognize LV Failure
  - With Display 2:13 min
  - Without Display 5:00 min
    - *p < .02*

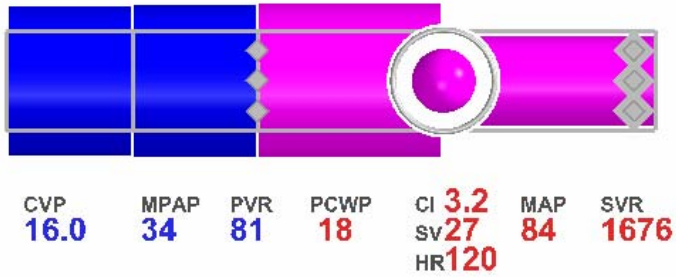

Agutter J, *Anesth Analg. 2003 97(5):1403-13*